

# WIRING DIAGRAM

## EZ-5 W/CS SERIES COND

### DWG NO. 510-005


### EZ-4 & EZ-3 W/CS COND

### ON OTHER SIDE

NOTE: ELECTRICAL PANEL MUST BE MOUNTED IN A DRY LOCATION WITH AN AMBIENT TEMP UNDER 150 DEG F

ELECTRICAL PANEL  
P/N 550-005

POS. BATTERY TERMINAL  
4 GA WIRE PROVIDED BY OTHERS

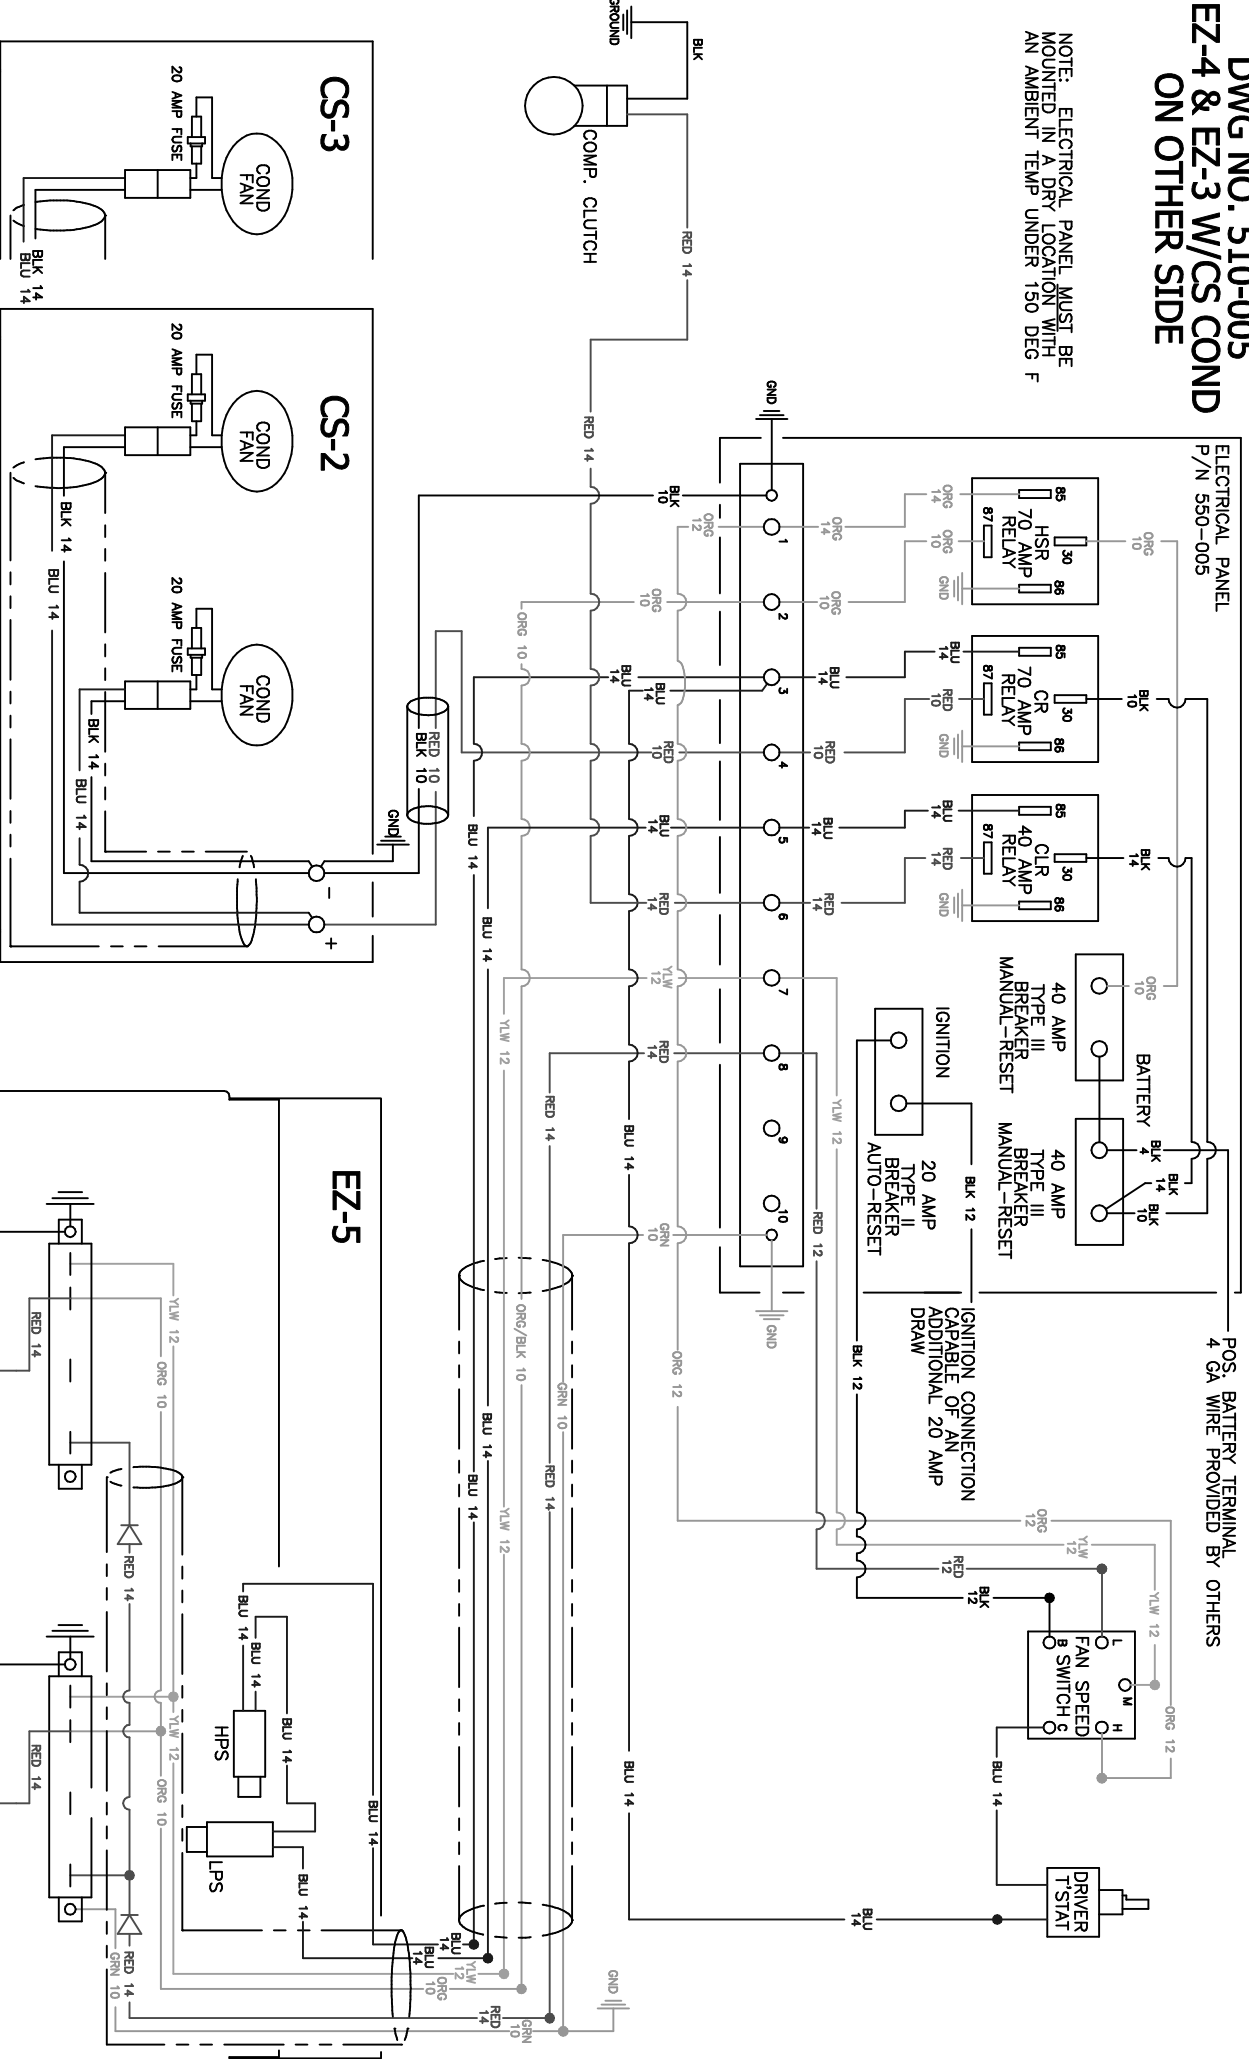

**AMERICAN COOLING TECHNOLOGY, Inc.**  
715 WILLOW SPRINGS LANE  
YORK, PA 17406  
FAX: (717) 767-3658  
(717) 767-2775

