


NOTE: ELECTRICAL PANEL MUST BE MOUNTED IN A DRY LOCATION WITH AN AMBIENT TEMP UNDER 150 DEG F

ELECTRICAL PANEL P/N 550-005

POS. BATTERY TERMINAL 4 GA WIRE PROVIDED BY OTHERS

WIRING DIAGRAM
EZ-5 W/CS COND
OEM GM TIE-IN
DWG NO. 510-095
EZ-3,35,4,55 W/CS COND
ON OTHER SIDE

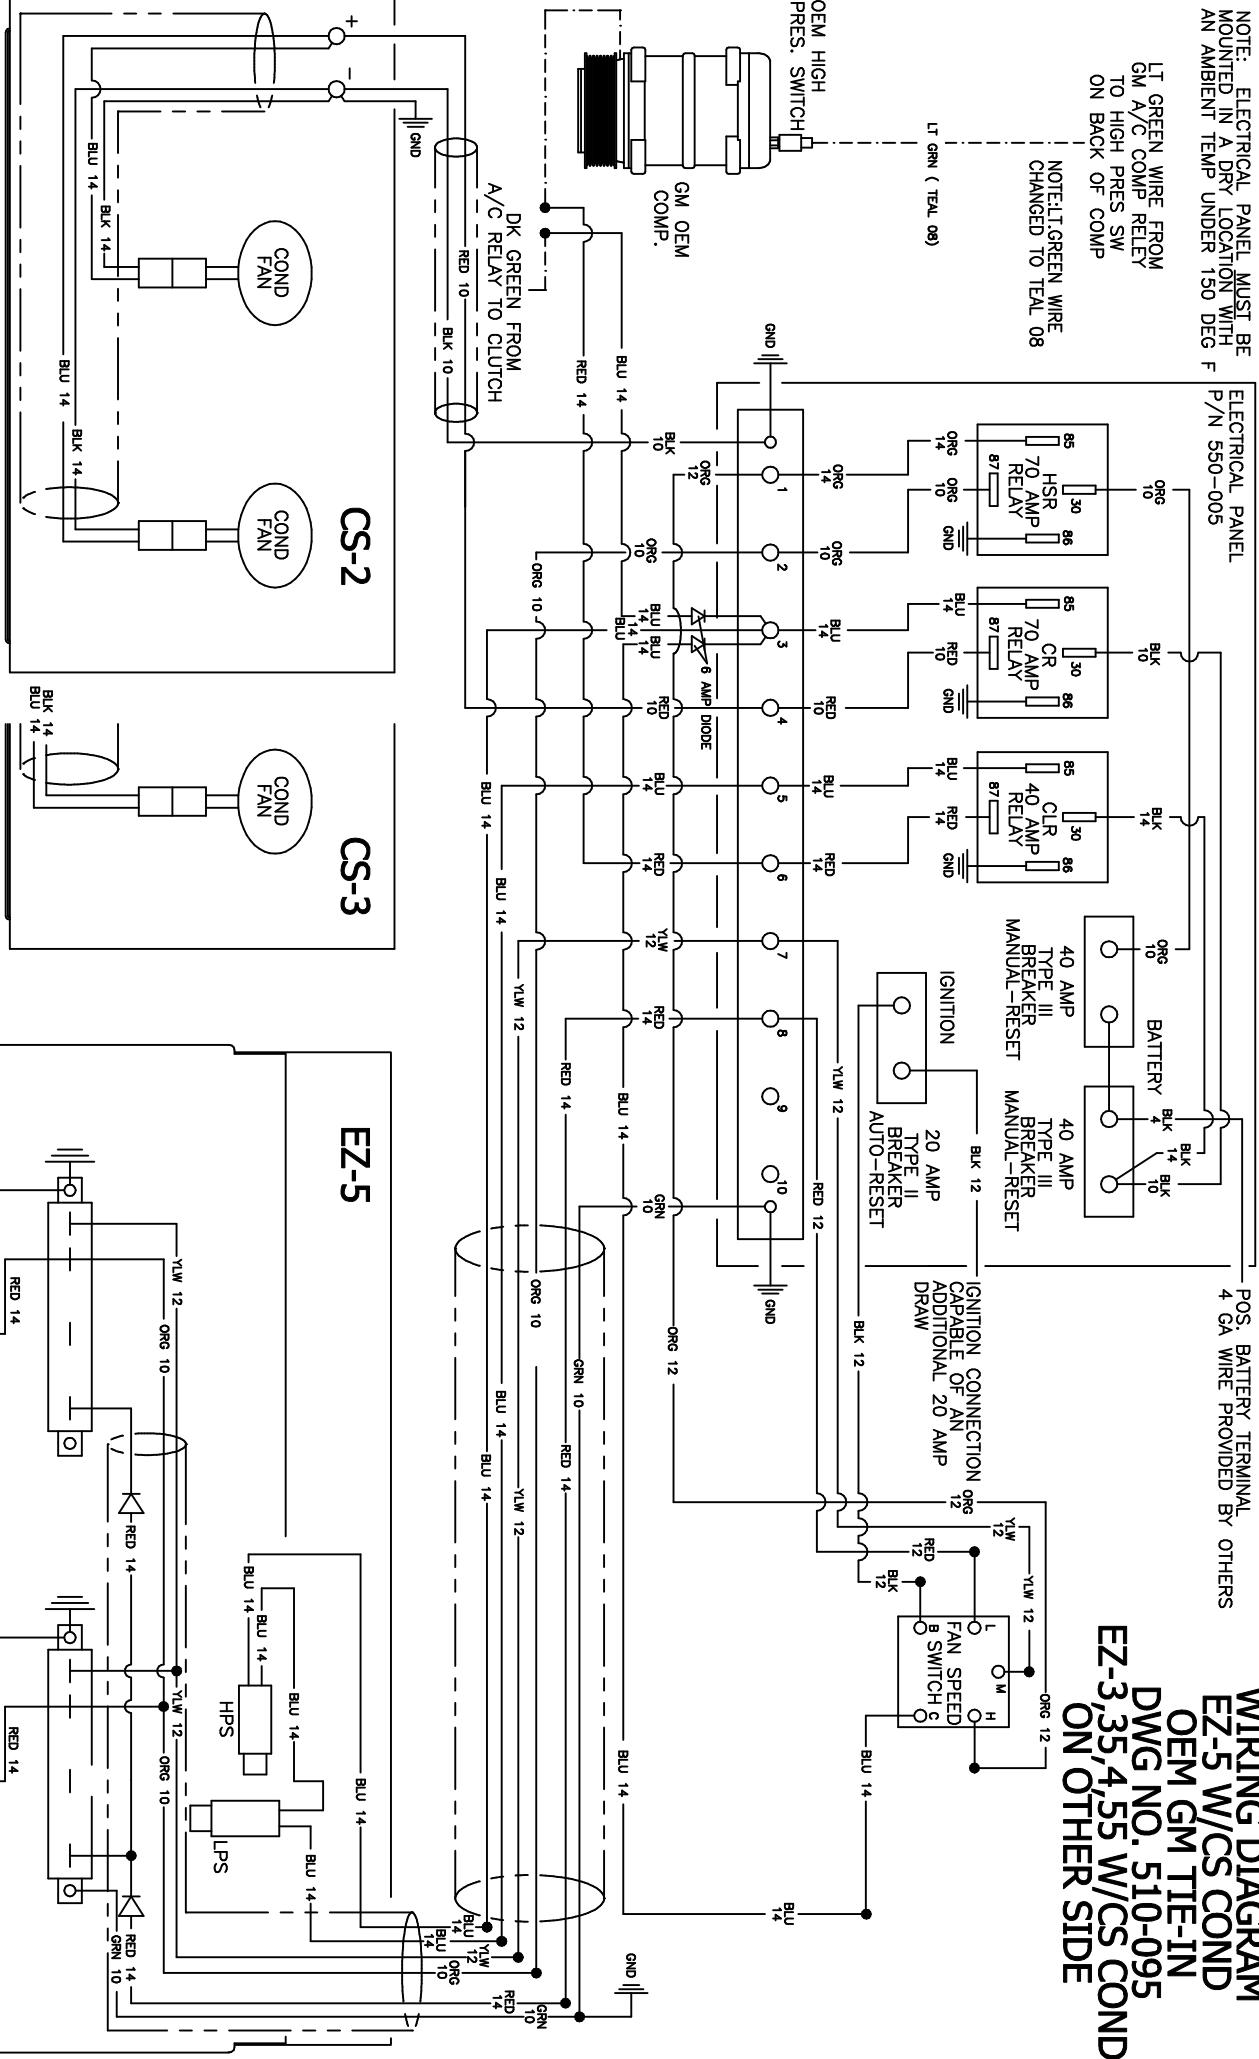

NOTE: LT GREEN WIRE FROM GM A/C COMP RELAY TO HIGH PRES SW ON BACK OF COMP

LT GRN (TEAL 08)

NOTE: LT GREEN WIRE CHANGED TO TEAL 08



AMERICAN COOLING TECHNOLOGY, Inc.
 715 WILLOW SPRINGS LANE
 YORK, PA 17402
 FAX: (717) 767-3658
 (717) 767-2775